

sales order 0000
 Item 0000
 Finish TRP


approved
 approved as noted
 not approved revise as noted

authorized signature _____ date _____

Custom Pike Rack
 No. BK-2230 (bad)
 UNDERWRITERS LABORATORIES INC. LISTED
 PHONE 540.942.1548 FAX 540.942.1417
 WEB ROLFING.COM
 Date 9/29/14
 Scale 3/32" = 1"



Front Elevation

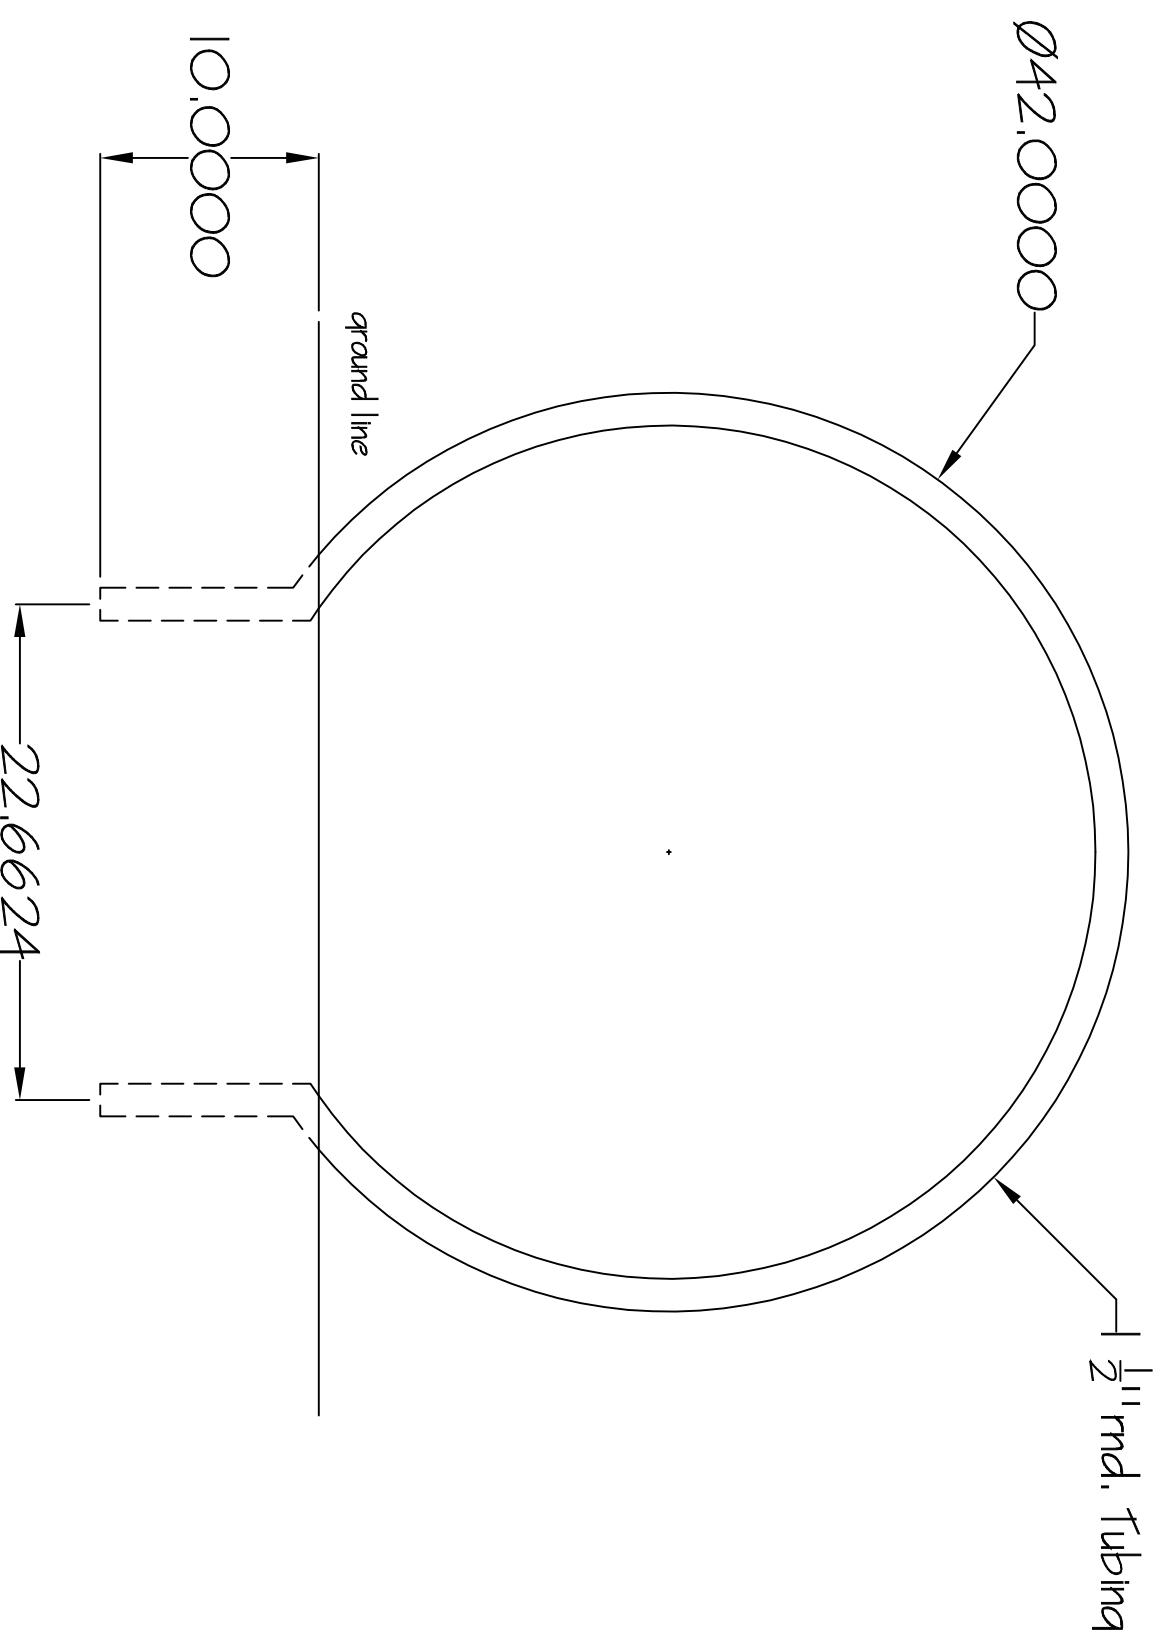

Side Elevation

